

SOUND TRANSMISSION LOSS TEST REPORT NO. TL21-228

CLIENT: **CEMCO**
13191 Crossroads Parkway North, Suite 325
City of Industry, CA 91746

21 April 2021

TEST DATE: 14 April 2021

INTRODUCTION

The test was performed in accordance with ASTM E 90-09 (2016), *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions* and ASTM E2235-04 (2020), *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*. Copies of the test standard are available at www.astm.org. The test chamber source and receiving room volumes are 204 and 148.4 cubic meters respectively. Western Electro-Acoustic Laboratory is accredited by the United States Department of Commerce, National Institute of Standards and Technology under the National Voluntary Accreditation Program (NVLAP) Lab Code 100256-0 for this test procedure. This test report relates only to the item(s) tested. This report must not be used to claim product certification, approval, or endorsement by WEAL, NVLAP, NIST or any agency of the federal government.

DESCRIPTION OF TEST SPECIMEN

The test specimen was a single 2x4 wood stud wall with type 'x' gypsum board, CEMCO RC1-XD resilient channel, and R-13 fiberglass insulation.

Specimen Make-up (Source to Receive)	
Layer 1	16 mm (5/8 inch) type 'x' gypsum board
Layer 2	16 mm (5/8 inch) type 'x' gypsum board
Framing and Insulation	89 mm (3-1/2 inch) deep wood studs with R-13 fiberglass batt insulation in the cavity
Resilient Attachment	13 mm (1/2 inch) CEMCO RC1-XD resilient channel
Layer 3	16 mm (5/8 inch) type 'x' gypsum board
Layer 4	16 mm (5/8 inch) type 'x' gypsum board
Installation Information	
Layer Installation	<ul style="list-style-type: none"> - Layer 1: 29 mm (1-1/8 inch) long #6 drywall screws spaced 203 mm (8 inches) on center (o.c.) at the perimeter and 305 mm (12 inches) o.c. in the field. - Layer 2: 50.8 mm (2 inch) long #6 drywall screws spaced 203 mm (8 inches) on center (o.c.) at the perimeter and 305 mm (12 inches) o.c. in the field. - Layer 3: 25.4 mm (1 inch) long #6 drywall screws spaced 305 mm (12 inches) o.c. along the resilient channel. - Layer 4: 41.2 mm (1-5/8 inch) long #6 drywall screws spaced 305 mm (12 inches) o.c. along the resilient channel. - All gypsum board was oriented vertically with joints staggered on opposite sides of the wall. - All joints and perimeters were sealed with a bead of caulking and metal foil tape
Resilient Attachment Installation	<ul style="list-style-type: none"> - Channel was installed to the studs using 32 mm (1-1/4 inch) Type S screws. - Channel was spaced vertically 610 mm (24 inches) o.c. and 76.2 mm (3 inches) from the top and bottom of the wall.
Framing and Insulation Installation	<ul style="list-style-type: none"> - Studs were spaced 406 mm (16 inches) o.c. - R-13 fiberglass batt insulation was friction-fit in the stud cavities. - The frame was isolated from the test chamber opening via neoprene pucks.



SOUND TRANSMISSION LOSS TEST REPORT NO. TL21-228

CLIENT: **CEMCO**

13191 Crossroads Parkway North, Suite 325
City of Industry, CA 91746

21 April 2021

TEST DATE: 14 April 2021

- The overall dimensions of the specimen were 2.44 m (96 inches) wide by 2.44 m (96 inches) high by 165 mm (6-1/2 inches) thick.
- The overall weight of the assembly was estimated to be 307 kg (677 lbs) for a calculated surface density of 51.6 kg/m² (10.6 lbs./ft²).

RESULTS OF THE MEASUREMENTS

One-third octave band sound transmission loss values are plotted and tabulated on the attached sheet. ASTM minimum volume requirements are met at 80 Hz and above. The Outdoor-Indoor Transmission Class rating determined in accordance with ASTM E 1332-10a was OITC-44. The Sound Transmission Class rating determined in accordance with ASTM E 413-10 was STC-59.

Respectfully submitted,

Approved:

Western Electro-Acoustic Laboratory

Stephen A. Martin, Ph.D., P.E.
Laboratory Director


Raul Martinez
Acoustical Test Technician

SOUND TRANSMISSION LOSS TEST REPORT NO. TL21-228

CLIENT: **CEMCO**
 13191 Crossroads Parkway North, Suite 325
 City of Industry, CA 91746

TEST DATE: 14 April 2021

21 April 2021

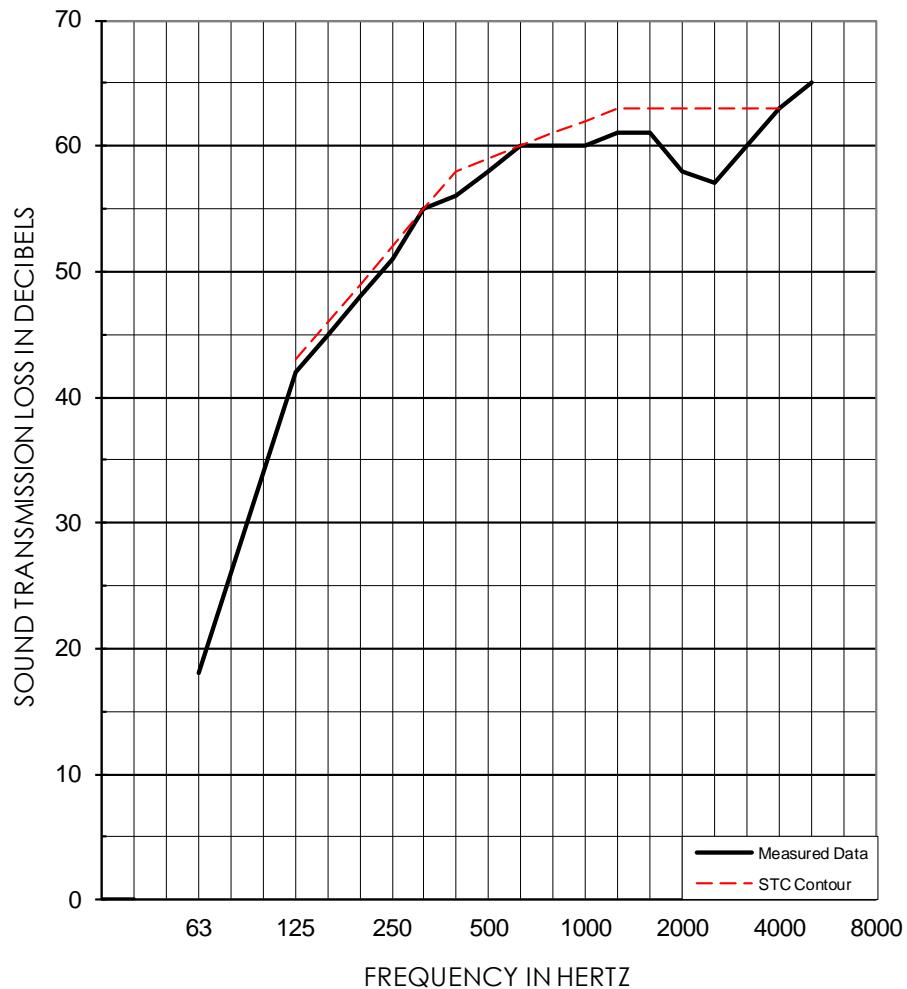

1/3 OCT BAND CNTR FREQ		63	80	100	125	160	200	250	315	400	500
TL in dB		18	26	34	42	45	48	51	55	56	58
95% Confidence in dB		1.42	1.92	2.07	1.47	0.89	0.76	0.80	0.52	0.36	0.38
deficiencies					(1)	(1)	(1)	(0)	(2)	(1)	(1)
1/3 OCT BAND CNTR FREQ		630	800	1000	1250	1600	2000	2500	3150	4000	5000
TL in dB		60	60	60	61	61	58	57	60	63	65
95% Confidence in dB		0.29	0.44	0.38	0.39	0.36	0.56	0.55	0.31	0.32	0.50
deficiencies		(0)	(1)	(2)	(2)	(2)	(5)	(6)	(3)	(0)	
EWR	OITC										STC
60	44										59
Test Date: 14 April 2021											(28)
Specimen Area: 64 sq.ft.											
Temperature: 70.2 deg. F											
Relative Humidity: 43 %											

Report must be distributed in its entirety except with written permission from Western Electro-Acoustic Laboratory